


Town of Siler City, NC
Low Level Show
 Display Site Plan

700 Alston Bridge Rd.
 Siler City, NC 27344

NOTES:
 Site plan is drawn to an approximate scale using NFPA 1123, NFPA 1126 or NFPA 160 as applicable.

REVISED DATE:
 6/23/25

Drawn By:
 Chaz Adams

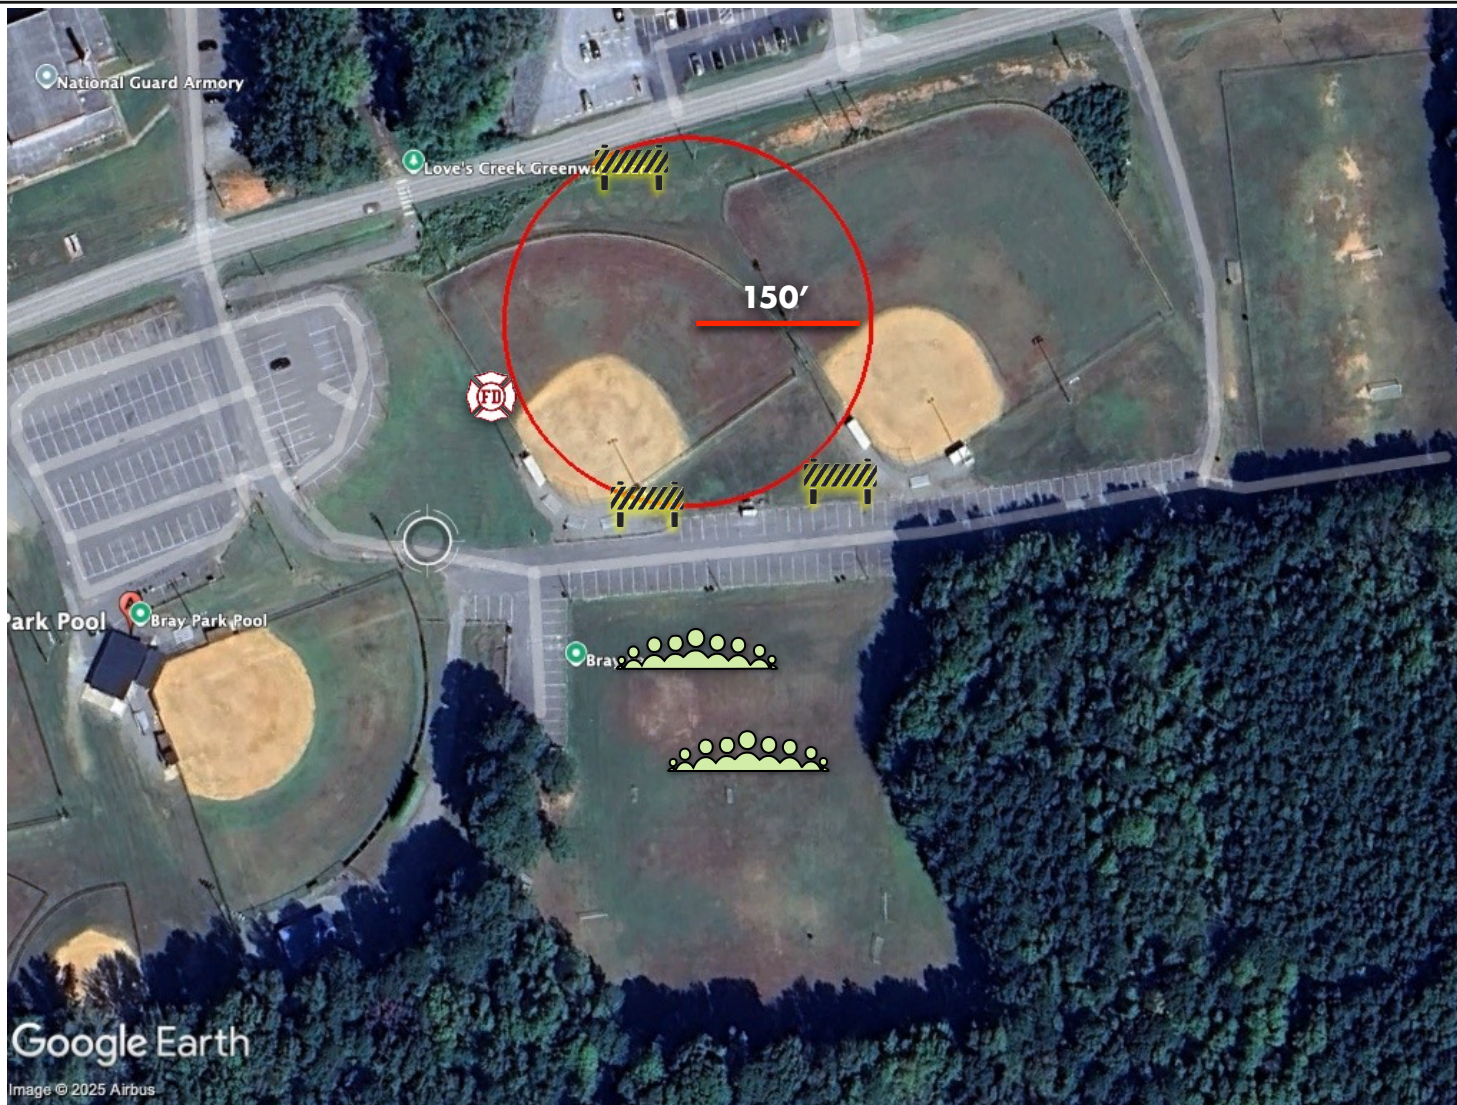

-  - Audience
-  - Radius
-  - Fire
-  - Closed

150' Safety Fall Out Radius

 - Safety Fall Out Zone

1.5" Maximum Device Per Pyrotecnico 100' Per Inch Policy

Town of Siler City, NC
3" Max show
 Display Site Plan

700 Alston Bridge Rd.
 Siler City, NC 27344

NOTES:
 Site plan is drawn to an approximate scale using NFPA 1123, NFPA 1126 or NFPA 160 as applicable.

REVISED DATE:
6/23/25

Drawn By:
Chaz Adams


 PYROTECNICO fx


 PYROTECNICO™
VITALE FAMILY FIREWORKS • 1889



 - Audience  - Radius
 - Fire
 - Closed

300' Safety Fall Out Radius

 - Safety Fall Out Zone **3" Maximum Device Per Pyrotecnico 100' Per Inch Policy**