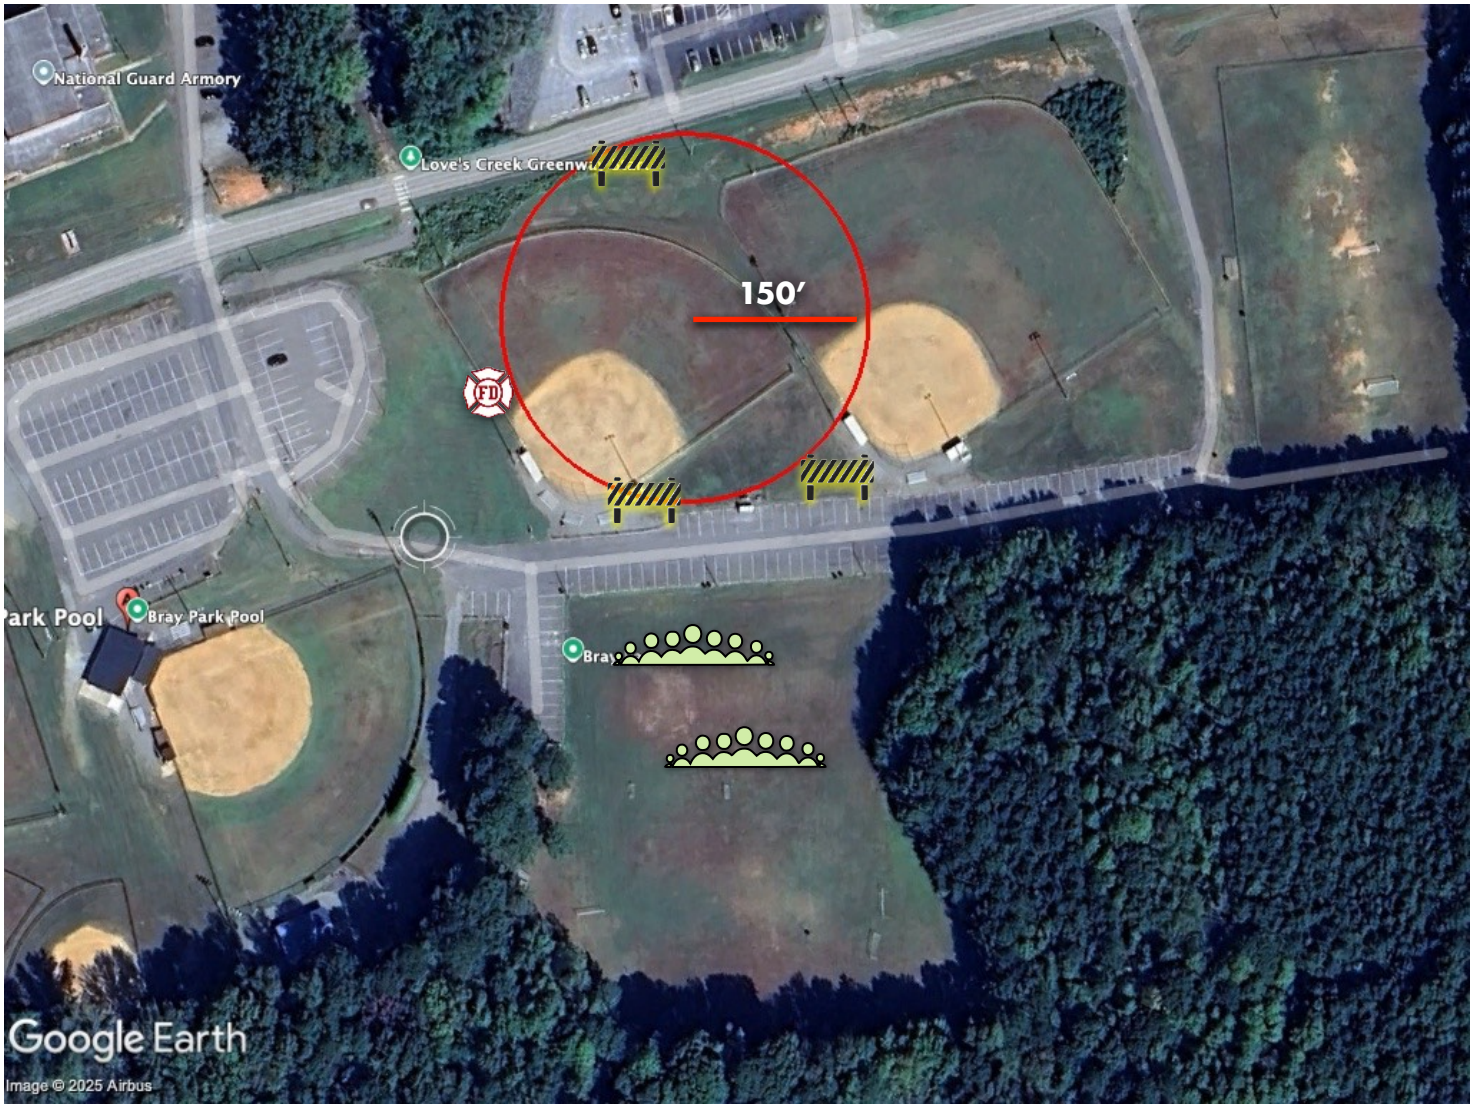

- Audience
- Radius
- Fire
- Closed
- Safety Fallout Zone

150' Safety Fall Out Radius

1.5" Maximum Device Per Pyrotecnico 100' Per Inch Policy

Town of Siler City, NC
Low Level Show
Display Site Plan

700 Alston Bridge Rd.
Siler City, NC 27344

NOTES:
Site plan is drawn to an approximate scale using NFPA 1123, NFPA 1126 or NFPA 160 as applicable.

REVISED DATE:
6/23/25

Drawn By:
Chaz Adams

PYROTECNICO fx

PYROTECNICO™
VITALE FAMILY FIREWORKS • 1889

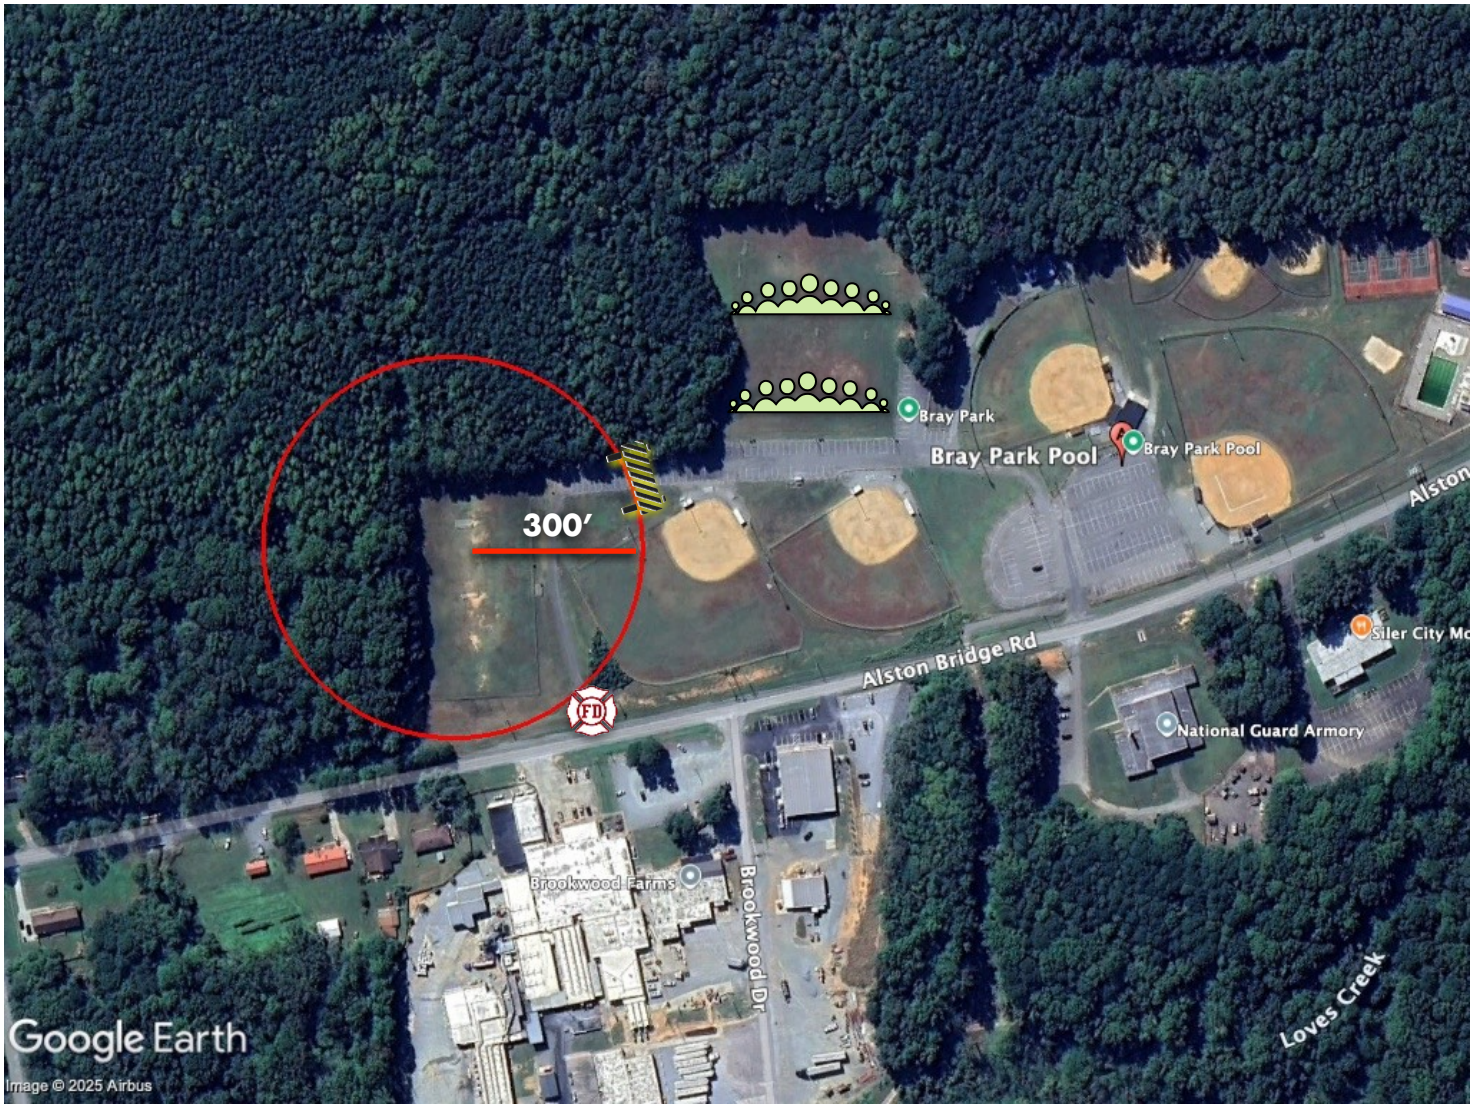

- Audience
- Radius
- Fire
- Closed
- Safety Fallout Zone

300′ Safety Fall Out Radius

3″ Maximum Device Per Pyrotecnico 100′ Per Inch Policy

Town of Siler City, NC
3″ Max show
Display Site Plan

700 Alston Bridge Rd.
Siler City, NC 27344

NOTES:
Site plan is drawn to an approximate scale using NFPA 1123, NFPA 1126 or NFPA 160 as applicable.

REVISED DATE:
6/23/25

Drawn By:
Chaz Adams

PYROTECNICO fx

PYROTECNICO™
VITALE FAMILY FIREWORKS • 1889